

A SURVEY OF MULTILEVEL INVERTER TOPOLOGIES FOR GRID INTEGRATION OF SOLAR

Masoom Soni¹, Akanksha Tiwari²

¹UG Scholar, Department of Electrical and Electronics Engineering, Technocrats Institute of Technology, Bhopal, India

ABSTRACT:

Multi-level inverters (MLI) are gaining research interest for utilizing solar energy since they serve two important purposes of converting DC output generated into usable AC output and maintaining the quality of power services. There are numerous research on-going related to the second aspects of inverters and they are popularly known as multi-functional inverters. In this paper a brief overview of multi-functional grid tied MLI has been briefly overviewed. The comparative analysis of available (MF-MLI) Multi-functional MLI has also been presented.

KEYWORDS: Multi-level inverters (MLI), Multi-functional MLI (MF-MLI), Neutral Point Coupling (NPC), Cascaded MLI (C-MLI), Point of Common Coupling (PCC).

1. INTRODUCTION

Solar systems generally employed as standalone system or grid connected inverters [1]. The standalone system generally supplies the local load like, rooftop system of remotely installed system where grid can't be reached [4, 5]. The grid connected system needs a proper synchronization to interact with the grid [2, 3]. The profitability of such system is worthy when the communication and power flow is two way. Which means power can either be supplied or can be consumed when needed. The available grid interactive PV system can be as shown in Fig.1. Various architecture and control topologies have been proposed in literature on integration of wind and solar energy systems and their hybrid combinations for power quality improvement when operated in a stand-alone as well as grid connected mode [6]-[8].

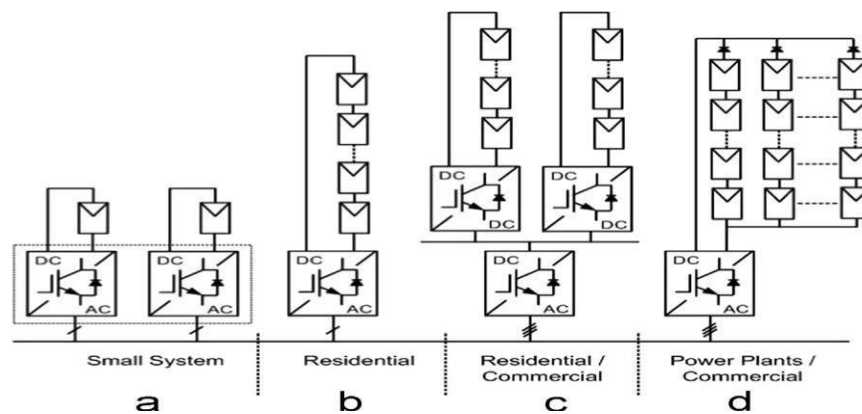


Fig. 1 Typical configuration of the grid interactive PV-system; (a) module inverter, (b) string inverter, (c) multi-string inverter, (d) central inverter.

2. MULTI FUNCTIONAL GRID INTERACTIVE MLI

In medium and high-power range utilizations, MF-MLI with grid technology is a very efficient alternative as the heart of interfacing systems for integration of PV systems into utility grid. The unbeatable harmonic-spectrum, low voltage rating of the power switches, decreased common mode voltages and lesser voltage changes (dv/dt) are important advantages of ML-MFGCI. However, the complexity of control method rises compared to the traditional two-level inverter. As illustrated in Fig. 2, ML-MFGCI can be classified based on the power circuit structure to mitigate PQ problems: (1) voltage source ML-MFGCI and (2) current source ML-MFGCI.

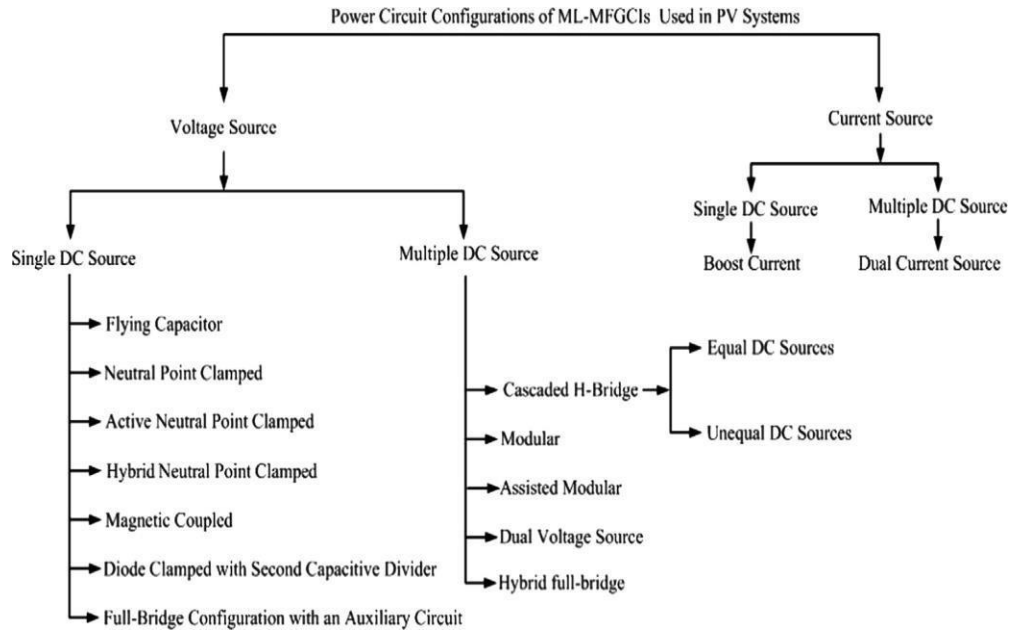


Fig. 2 Classification of MF-MLI.

2.1 Neutral point clamped (NPC-MF-MLI)

The NPC is designed by a series combination of power switches whose connecting point is clamped by the combination of two diodes between consecutive pairs and the neutral point is clamped with the combination of capacitors as shown in fig.3 (a) [13]-[15]. The negative point of the upper inverter and the positive point of the lower one are assembled together to constitute the new phase output, while to make the neutral point N, the initial phase outputs are connected via two clamping diodes. These are efficient in applications operating at fundamental frequency switching [16].

2.2 Flying Capacitor (FC-MF-MLI)

The structural combination of FCMLI is similar to NPCMLI only difference is that the diodes are replaced by capacitors as shown in fig. 3 (b). In this topology the load cannot be directly connected to the neutral, but, the zero level is achieved by connecting the load to the positive or negative side through the flying capacitor with opposite polarity with respect to the DC-link [17].

2.3 Cascaded (C-MF-MLI)

CHB-MFGCI is composed of the series connection of two or more single phase H-bridge inverters as shown in Fig. 3(c). Each H-bridge inverter corresponds to two voltage source phase legs, where the line to line voltage is the inverter output voltage. Therefore, a single H-bridge inverter can generate three different voltage levels. To avoid DC-link capacitor being short circuits, each leg has two possible switching positions. The zero level can be obtained by connecting the phase outputs to the positive or the negative sides of the inverter. The comparison and functionality based on their classification is presented in table2. Table 1 presents the nomenclature for the table 2.

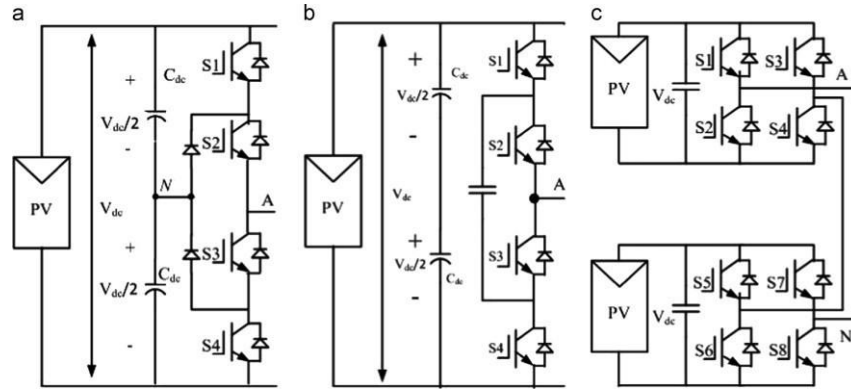


Fig 3. Power circuit configuration of Three-level (a) NPC-MF-MLI, (b) FC-MF-MLII, (c) C-MF-MLII.

Table 1. Abbreviations of MF-MLI configurations.

Abbreviation	Description
VSMF-MLI	Voltage source MF-MLI
CSMF-MLI	Current source MF-MLI
NPC-MF-MLII	Neutral point clamped MF-MLI
ANPC-MF-MLI	Active neutral point clamped MF-MLI
DC-MF-MLI	Diode clamped MF-MLI
FC-MF-MLI	Flying capacitor MF-MLI
CHB-MF-MLI	Cascaded H-bridge MF-MLI
ACHB-MF-MLI	Asymmetric cascaded H-bridge MF-MLI
DVS-MF-MLI	Dual voltage source MF-MLI
PFC	Power factor correction
APF	Active power filter

Functionality	Topology	Levels number	Control method
APF,PFC [13]	C-MF-MLI	7	-
APF,PFC	C-MF-MLI	11	Pq with PI and repetitive controller

International Journal of Recent Innovation and Trends in Mechanical Engineering Vol.(1), Issue (1), 2019.

[14]			
APF [15]	C-MF-MLI	7	-
PFC [16]	Full bridge with auxiliary circuit	5	Digital PI current control algorithm
PFC[17]	C-MF-MLI	13	-
PFC [18]	AM-MFGCI	31	pq
PFC [19]	DCMF-MLI	3	
PFC [20]	DCMF-MLI with second capacitive divider	5	Digital PI current control algorithm
PFC [21]	C-MF-MLI	5	PI current control algorithm
PFC [2]2	Full bridge with auxiliary circuit	5	Digital PI current control algorithm
PFC [23]	C-MF-MLI	5	PI and PR current control algorithm
PFC [24]	AC-MF-MLI	19	Average power control
PFC [25]	C-MF-MLI	3	Dual loop current controller
PFC [26]	C-MF-MLI	9	pq based a fully FLC without any PWM and PI controller
PFC [27]	M-MF-MLI	3	Dq current control
APF,PFC [28]	C-MF-MLI	21	pq
APF,PFC [29]	DVS-MF-MLI	3	PI base current control
APF,PFC [30]	NP C-MF-MLI	3	The pq theory (pq0-current control),

3. CONCLUSION

This paper present a brief overview of new type of MLI that is multifunctional MLI topology which serves PQ issues while integrating PV with the utility system. There are numerous research on-going related to the second aspects of inverters and they are popularly known as multi- functional inverters. In this paper a brief overview of multi-functional grid tied MLI has been briefly overviewed. The comparative analysis of available (MF-MLI) Multi-functional MLI has also been presented.

REFERENCES

- [1] Ameli, M. T., Moslehpour, S., & Shamlo, M. (2008). Economical load distribution in power networks that include hybrid solar power plants. *Electric Power Systems Research*, 78(7), 1147-1152.
- [2] Manojkumar, M., Porkumaran, K., & Kathirvel, C. (2014, March). Power electronics interface for hybrid renewable energy system—A survey. In *2014 International Conference on Green Computing Communication and Electrical Engineering (ICGCCEE)* (pp. 1-9). IEEE.
- [3] Gomaa, S., Seoud, A. A., & Kheiralla, H. N. (1995). Design and analysis of photovoltaic and wind energy hybrid systems in Alexandria, Egypt. *Renewable energy*, 6(5-6), 643-647.
- [4] Kellogg, W. D., Nehrir, M. H., Venkataramanan, G., & Gerez, V. (1998). Generation unit sizing and cost analysis for stand-alone wind, photovoltaic, and hybrid wind/PV systems. *IEEE Transactions on energy conversion*, 13(1), 70-75.
- [5] Marnay, C., Venkataramanan, G., Stadler, M., Siddiqui, A. S., Firestone, R., & Chandran, B. (2008). Optimal technology selection and operation of commercial-building microgrids. *IEEE Transactions on Power Systems*, 23(3), 975-982.
- [6] Khare, V., Nema, S., & Baredar, P. (2016). Solar–wind hybrid renewable energy system: A review. *Renewable and Sustainable Energy Reviews*, 58, 23-33.
- [7] Arul, P. G., Ramachandaramurthy, V. K., & Rajkumar, R. K. (2015). Control strategies for a hybrid renewable energy system: A review. *Renewable and sustainable energy reviews*, 42, 597-608.
- [8] Bratcu, A. I., Munteanu, I., & Ceanga, E. (2008, June). Optimal control of wind energy conversion systems: from energy optimization to multi-purpose criteria-a short survey. In *2008 16th Mediterranean Conference on Control and Automation* (pp. 759-766). IEEE.

- [9] Martinez, J. A., Dinavahi, V., Nehrir, M. H., & Guillaud, X. (2011). Tools for analysis and design of distributed resources—Part IV: Future trends. *IEEE Transactions on Power Delivery*, 26(3), 1671-1680.
- [10] Lago, J., & Heldwein, M. L. (2011). Operation and control-oriented modeling of a power converter for current balancing and stability improvement of DC active distribution networks. *IEEE Transactions on Power Electronics*, 26(3), 877-885.
- [11] Das, V., Padmanaban, S., Venkitusamy, K., Selvamuthukumaran, R., Blaabjerg, F., & Siano, P. (2017). Recent advances and challenges of fuel cell based power system architectures and control—A review. *Renewable and Sustainable Energy Reviews*, 73, 10-18.
- [12] Brahma, S. M. (2011). Fault location in power distribution system with penetration of distributed generation. *IEEE transactions on power delivery*, 26(3), 1545-1553.
- [13] Shirek, G. J., & Lassiter, B. A. (2013). Photovoltaic power generation: modeling solar plants' load levels and their effects on the distribution system. *IEEE Industry Applications Magazine*, 19(4), 63-72.
- [14] Nehrir, M. H., Wang, C., Strunz, K., Aki, H., Ramakumar, R., Bing, J., ... & Salameh, Z. (2011). A review of hybrid renewable/alternative energy systems for electric power generation: Configurations, control, and applications. *IEEE transactions on sustainable energy*, 2(4), 392-403.
- [15] F. A. Farret and M. G. Simões, *Integration of alternative Sources of Energy*. Hoboken, NJ: Wiley, 2006.
- [16] Ko, S. H., Lee, S. R., Dehbonei, H., & Nayar, C. V. (2006). Application of voltage-and current-controlled voltage source inverters for distributed generation systems. *IEEE Transactions on Energy Conversion*, 21(3), 782-792.
- [17] Ghafoor, A., & Munir, A. (2015). Design and economics analysis of an off-grid PV system for household electrification. *Renewable and Sustainable Energy Reviews*, 42, 496-502.
- [18] Pinomaa, A., Ahola, J., & Kosonen, A. (2011, April). Power-line communication-based network architecture for LVDC distribution system. In *2011 IEEE International Symposium on Power Line Communications and Its Applications* (pp. 358-363). IEEE.
- [19] Prodanovic, M., & Green, T. C. (2006). High-quality power generation through distributed control of a power park microgrid. *IEEE Transactions on Industrial Electronics*, 53(5), 1471-1482.
- [20] Guerrero, J. M., Matas, J., de Vicuna, L. G., Castilla, M., & Miret, J. (2007). Decentralized control for parallel operation of distributed generation inverters using resistive output impedance. *IEEE Transactions on industrial electronics*, 54(2), 994-1004.
- [21] Maharjan, L., Inoue, S., & Akagi, H. (2008). A transformerless energy storage system based on a cascade multilevel PWM converter with star configuration. *IEEE Transactions on Industry Applications*, 44(5), 1621-1630.
- [22] Lago, J., & Heldwein, M. L. (2011). Operation and control-oriented modeling of a power converter for current balancing and stability improvement of DC active distribution networks. *IEEE Transactions on Power Electronics*, 26(3), 877-885.
- [23] Tsikalakis, A. G., & Hatziaargyriou, N. D. (2011, July). Centralized control for optimizing microgrids operation. In *2011 IEEE power and energy society general meeting* (pp. 1-8). IEEE.
- [24] Guerrero, J.M.; Vasquez, J.C.; Matas, J.; Castilla, M.; de Vicuna, L.G., "Control Strategy for Flexible Microgrid Based on Parallel Line- Interactive UPS Systems," *Industrial Electronics, IEEE Transactions*, vol.56, no.3, pp.726,736, March 2009.
- [25] Fei Wang; Duarte, J.L.; Hendrix, M.A.M., "Grid-Interfacing Converter Systems With Enhanced Voltage Quality for Microgrid Application— Concept and Implementation," *Power Electronics, IEEE Transactions*, vol.26, no.12, pp.3501,3513, Dec. 2011.
- [26] Abdelsalam, A. K., Massoud, A. M., Ahmed, S., & Enjeti, P. N. (2011). High-performance adaptive perturb and observe MPPT technique for photovoltaic-based microgrids. *IEEE Transactions on Power Electronics*, 26(4), 1010-1021.
- [27] Johnson, K. E., Fingersh, L. J., Balas, M. J., & Pao, L. Y. (2004). Methods for increasing region 2 power capture on a variable-speed wind turbine. *J. Sol. Energy Eng.*, 126(4), 1092-1100.
- [28] Miñambres-Marcos V, Romero-Cadavale, Milanes-Montero MI, Guerrero-Martínez, MA, Barrero-González, CastrilloF,PG. "Power injection system for photo-voltaic plants based on a multi-converter topology with dc-link capacitor voltage balancing. In *12th International conference on optimization of electrical and electronic equipment*. Basov,20–22 May2010. p.1121–1130.